



# Consumer Confidence Report



An Annual Drinking Water Quality Report  
Published June 2026

Data for January 1, 2025  
through December 31, 2025



Municipal Water District

A Public Agency Providing  
Water

Wastewater Services

Recycled Water

Hydroelectricity


Elfin Forest Recreational Reserve

## Olivenhain Municipal Water District is required by law to distribute a Consumer Confidence Report each year.

This report explains how drinking water provided by Olivenhain Municipal Water District (OMWD) meets or exceeds all state and federal water quality standards for your drinking water. Included within are an explanation of where your water comes from, results of water quality tests, and tips on how to interpret the data. The data presented is for January 1, 2025 through December 31, 2025. We are proud to share our results with you.



## Your Water Sources

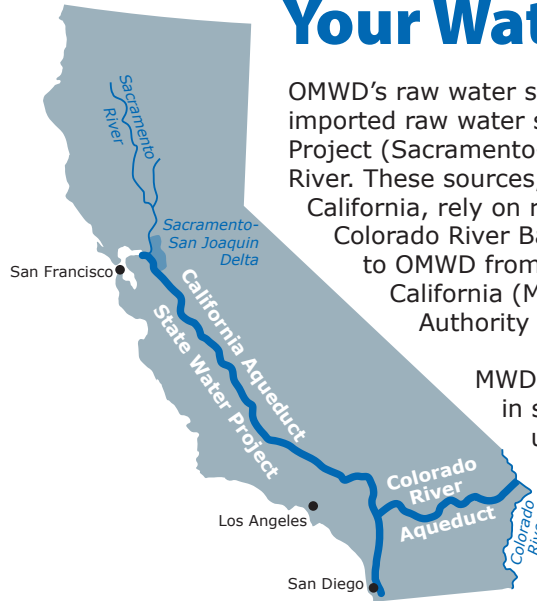

OMWD’s raw water supply in 2025 was 100% imported. The imported raw water sources are the California State Water Project (Sacramento-San Joaquin Delta) and the Colorado River. These sources, supplying water to all of Southern California, rely on runoff from the Sierra snowpack and the Colorado River Basin. Both of these supplies are provided to OMWD from Metropolitan Water District of Southern California (MWD) and San Diego County Water Authority (SDCWA).

MWD maintains Lake Skinner, located in southwest Riverside County, as the untreated raw water source for San Diego County. Before water from Lake Skinner is delivered to you, it is treated to remove pollutants and bacteria. OMWD delivers water to your home or business that has been treated at its David C. McCollom Water Treatment Plant (DCMWTP).

### David C. McCollom Water Treatment Plant

In 2025, approximately 78.07% of the water delivered to OMWD customers was treated locally at DCMWTP. The raw water received at DCMWTP is a blend of water from the Colorado River and the State Water Project. This raw water is obtained from SDCWA, which purchases it from MWD. The remaining percentage of treated water delivered to OMWD customers was purchased from SDCWA and treated at either the Twin Oaks Valley Water Treatment Plant, the Claude “Bud” Lewis Carlsbad Desalination Plant, and/or MWD’s Robert A. Skinner Water Treatment Plant.

DCMWTP is located within the northeastern portion of OMWD’s service area and uses membrane technology to produce superior quality finished water. The membrane process uses fewer chemicals than conventional treatment methods, and offers improved barriers against pathogens, such as *Cryptosporidium*, viruses, and bacteria, such as coliform. Public tours of DCMWTP may be available; visit [www.olivenhain.com/events](http://www.olivenhain.com/events) for details.

## What Is In My Water?

The tables on the following pages show how water quality for OMWD met drinking water quality standards in 2025. The tables also show data specific to the treated water that flows through OMWD’s distribution system, and where noted, raw water quality from the Lake Skinner water source. For information on the Lake Skinner source water and a source water assessment, please contact Paul Rochelle with MWD at **909-392-5155** or [prochelle@mwdh2o.com](mailto:prochelle@mwdh2o.com). For information on SDCWA’s water treatment plants, including the Twin Oaks Valley Water Treatment Plant or the Claude “Bud” Lewis Carlsbad Desalination Plant, please contact Chris Castaing with SDCWA at **760-233-3264** or [ccastaing@sdcwa.org](mailto:ccastaing@sdcwa.org) or visit SDCWA’s website at [www.sdcwa.org/your-water/water-quality](http://www.sdcwa.org/your-water/water-quality).

For more information on OMWD’s DCMWTP or distribution system, please contact OMWD’s Operations Manager at [waterquality@olivenhain.com](mailto:waterquality@olivenhain.com) or **760-753-6466**.

## How Do Contaminants Get in the Water?

The raw sources of drinking water (both tap and bottled water alike) include rivers, lakes, streams, ponds, reservoirs, springs, and wells. As water travels over the surface of the land or through the ground, it dissolves naturally occurring minerals and, in some cases, radioactive material. It can also pick up substances resulting from the presence of animals and/or from human activity. Contaminants that may be present in raw source water include:

- **Microbial contaminants**, such as viruses and bacteria, that may come from sewage treatment plants, septic systems, agricultural livestock operations, and wildlife
- **Inorganic contaminants**, such as salts and metals, that can be naturally occurring or resulting from urban stormwater runoff, industrial or domestic wastewater discharges, oil and gas production, mining, or farming
- **Pesticides and herbicides**, which may come from a variety of sources such as agriculture, urban stormwater runoff, and residential uses
- **Organic chemical contaminants**, including synthetic and volatile organic chemicals, that are by-products of industrial processes and petroleum production, and can also come from gas stations, urban stormwater runoff, agricultural application, and septic systems
- **Radioactive contaminants**, which can be naturally occurring or be the result of oil and gas production and mining activities

In order to ensure that tap water is safe to drink, the US Environmental Protection Agency (USEPA) and California's State Water Resources Control Board (SWRCB) prescribe regulations that limit the amount of certain contaminants in water provided by public water systems. US Food and Drug Administration regulations and California law also establish limits for contaminants in bottled water that provide the same protection for public health.

## What About Lead and Copper?

OMWD is required to test every three years for lead and copper. OMWD tested for lead and copper in 2025; 30 locations were sampled, and the results, which were well below regulatory action levels, are provided in the table on page 6. Additional information about lead and copper is available from the USEPA Safe Drinking Water Hotline, 800-426-4791, and at [www.olivenhain.com/leadandcopper](http://www.olivenhain.com/leadandcopper).

In compliance with the SWRCB Drinking Water Permit Amendment 2017PA-SCHOOLS and Assembly Bill 746 (2017), OMWD tested seven school locations for lead in 2017, six schools in 2018, and one school performed lead testing in 2019. The action level of 15 ppb was not exceeded at any location. Customers can request school lead testing results by contacting the Division of Drinking Water at [DDW-PLU@waterboards.ca.gov](mailto:DDW-PLU@waterboards.ca.gov) or **916-322-9602**.

In 2024, OMWD completed an initial Lead Service Line Inventory required by the USEPA's Lead and Copper Rule Revision. OMWD found no lead lines, galvanized requiring replacement lines, or unknown lines in private plumbing connected to OMWD's distribution system. OMWD continues efforts inspecting and recording the material making up service lines connecting to OMWD's system. Visit [www.olivenhain.com/leadandcopper](http://www.olivenhain.com/leadandcopper) for more information.

If present, elevated levels of lead can cause serious health problems, especially for pregnant women and young children. Lead in drinking water is primarily from materials and components associated with service lines and home plumbing. OMWD is responsible for providing high-quality drinking water, but cannot control the variety of materials used in home plumbing components. When your water has been sitting for several hours, you can minimize the potential for lead exposure by flushing your tap for 30 seconds to two minutes before using water for drinking or cooking. If you are concerned about lead in your water, you may wish to have your water tested. Information on lead in drinking water, testing methods, and steps you can take to minimize exposure is available from the USEPA Safe Drinking Water Hotline, **800-426-4791**, or at [www.epa.gov/safewater/lead](http://www.epa.gov/safewater/lead).

## Important Health Information

Drinking water, including bottled water, may reasonably be expected to contain at least small amounts of some contaminants. The presence of contaminants does not necessarily indicate that water poses a health risk. More information about contaminants and potential health effects can be obtained by calling the USEPA's Safe Drinking Water Hotline, **800-426-4791**.

The trace contaminants found in OMWD's water sources, along with their standards, are listed in the tables found in this report. It is important to note that drinking water standards are based on research to protect the general public and may not be sufficient to protect certain persons, as noted below.

Some people may be more vulnerable to contaminants in drinking water than the general population. Immuno-compromised persons, such as persons with cancer undergoing chemotherapy, persons who have undergone organ transplants, people with HIV/AIDS or other immune system disorders, as well as some elderly and infants can be particularly at risk for infections. These people should seek advice from their health care providers about drinking water. USEPA/Center for Disease Control guidelines on appropriate means to lessen the risk of infection by *Cryptosporidium* and other microbial contaminants are available from the USEPA's Safe Drinking Water Hotline, **800-426-4791**.

# Water Quality Data

Parameter	Units	State or Federal MCL	PHG	State DLR	OMWD's DCMWTP <sup>(a)</sup>	
					Range	Average
<b>COMPLIANCE MONITORING</b>						
<b>Inorganic Chemicals</b>						
Arsenic	ppb	10	0.004	2	2.0	2.0
Fluoride (naturally occurring)	ppm	2.0	1	0.1	0.19 - 0.32	0.25
Fluoride (treated water) <sup>(b)</sup>					0.64 - 0.78	0.72
<b>RADIOLOGICALS</b>						
Uranium	pCi/L	20	0.43	1	1.8	1.8
<b>CLARITY</b>						
Combined Filter Effluent Turbidity <sup>(c)</sup>	NTU %	TT	NA	NA	100% ≤ 0.1	Highest 0.074
<b>SECONDARY STANDARDS – Aesthetic Standards<sup>(d)</sup></b>						
Chloride	ppm	500	NA	NA	96	96
Color	Color Units	15	NA	NA	ND	ND
Odor Threshold	TON	3	NA	NA	ND	ND
Specific Conductance	µS/cm	1,600	NA	NA	800	800
Sulfate	ppm	500	NA	NA	140	140
Total Dissolved Solids (TDS)	ppm	1,000	NA	NA	470	470
Turbidity <sup>(e)</sup>	NTU	5	NA	NA	0.013 - 0.074	0.021
<b>OTHER PARAMETERS</b>						
<b>Chemicals</b>						
Alkalinity	ppm	NA	NA	NA	100 - 110	106
Calcium	ppm	NA	NA	NA	50	50
Hardness	ppm	NA	NA	NA	200	200
Magnesium	ppm	NA	NA	NA	19	19
pH	pH Units	NA	NA	NA	8.2	8.2
Potassium	ppm	NA	NA	NA	4.1	4.1
Silica	ppm	NA	NA	NA	7.4	7.4
Sodium	ppm	NA	NA	NA	79	79
Total Organic Carbon (TOC)	ppm	TT	NA	0.30	2.4 - 4.8	2.9
<b>UNREGULATED CONTAMINANTS</b>						
<b>Chemicals</b>						
Lithium <sup>(e)</sup>	ppb	NA	NA	NA	NA	NA
Perfluorobutanoic Acid (PFBA) <sup>(f)</sup>	ng/L	NA	NA	2.0	ND - 2.9	Highest Level 2.9

## Major Sources in Drinking Water

Erosion of natural deposits; runoff from orchards; glass and electronics production wastes

Erosion of natural deposits; discharge from fertilizer and aluminum factories

Water additive that promotes strong teeth

Erosion of natural deposits

Soil runoff

Runoff/leaching from natural deposits; seawater influence

Naturally occurring organic materials

Naturally occurring organic materials

Substances that form ions in water; seawater influence

Runoff/leaching from natural deposits; industrial wastes

Runoff/leaching from natural deposits

Soil runoff

Runoff/leaching from natural deposits; carbonate, bicarbonate, hydroxide, and occasionally borate, silicate, and phosphate

Runoff/leaching from natural deposits

Runoff/leaching from natural deposits; sum of polyvalent cations, generally magnesium and calcium, present in the water

Runoff/leaching from natural deposits

Inherent characteristic of water, naturally occurring

Salt present in the water; naturally occurring

Naturally occurring

Salt present in the water; naturally occurring

Various natural and man-made sources

Naturally occurring; used in electrochemical cells, batteries, and organic syntheses and pharmaceuticals

Discharge from manufacturing and industrial chemical facilities, use of certain consumer products, occupational exposures, and certain firefighting activities

## Abbreviations and Definitions

**AL** – Action Level – *The concentration of a contaminant which, if exceeded, triggers treatment or other requirements that a water system must follow.*

**Average** – Result based on arithmetic mean

**CFU** – Colony-Forming Units

**DLR** – A number established by SWRCB as a reporting threshold. While a result above the DLR must be reported in the CCR, it does not denote a regulatory exceedance.

**HAA5** – Haloacetic Acids (five regulated acids)

**LRAA** – Locational Running Annual Average – *The highest LRAA is the highest of all Locational Running Annual Averages calculated as average of all samples collected within a 12-month period.*

**MCL** – Maximum Contaminant Level – *The highest level of a contaminant that is allowed in drinking water. Primary MCLs are set as close to the PHGs as is economically and technologically feasible. Secondary MCLs are set to protect the odor, taste, and appearance of drinking water.*

**MCLG** – Maximum Contaminant Level Goal – *The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are set by the US Environmental Protection Agency.*

**MRDL** – Maximum Residual Disinfectant Level

**MRDLG** – Maximum Residual Disinfectant Level Goal – *The level of a drinking water disinfectant below which there is no known or expected risk to health. MRDLGs do not reflect the benefits of the use of disinfectants to control microbial contaminants.*

**NA** – Not Applicable

**ND** – Not Detectable

**NL** – Notification Level to the SWRCB

**NTU** – Nephelometric Turbidity Units

**pCi/L** – Picocuries per Liter

**PFAS** – Per- and Polyfluoroalkyl Substances

**PHG** – Public Health Goal – *The level of a contaminant in drinking water below which there is no known or expected risk to health. PHGs are set by the California Environmental Protection Agency.*

**ppb** – Parts per billion or micrograms per liter ( $\mu\text{g/L}$ )

**ppm** – Parts per million or milligrams per liter ( $\text{mg/L}$ )

**ppt** – Parts per trillion or nanograms per liter ( $\text{ng/L}$ )

**RAA** – Running Annual Average – *The highest RAA is the highest of all Running Annual Averages calculated as average of all the samples collected within a 12-month period.*

**Range** – Results based on minimum and maximum values

**TCR** – Total Coliform Rule

**TON** – Threshold Odor Number

**TT** – Treatment Technique does not refer to any range of values. If EPA has not set an MCL, TT is a required process intended to reduce the contaminant level in drinking water.

**TTHM** – Total Trihalomethanes

**$\mu\text{S/cm}$**  – Microsiemens per centimeter; or micromhos per centimeter ( $\mu\text{mho/cm}$ )

# Water Quality Data

Parameter		State or Federal MCL [MRDL]	PHG (MCLG) [MRDLG]	State DLR	OMWD's Distribution System		Major Sources in Drinking Water
					Range	Average	
<b>Treated Water Data – Distribution System</b>							
<b>PRIMARY STANDARDS – Mandatory Health-Related Standards</b>							
<b>MICROBIOLOGICAL</b>							
<i>E. coli</i> (Acute Total Coliform) <sup>(g)</sup>	NA	0	(0)	NA	ND	ND	Human and animal fecal waste
Total Coliform Bacteria <sup>(h)</sup>	NA	TT	NA	NA	ND	ND	Naturally present in the environment
<b>DISINFECTION BY-PRODUCTS AND DISINFECTANT RESIDUALS</b>							
Haloacetic Acids (five) (HAA5) <sup>(i)</sup>	ppb	60	NA	1	8.0 - 30.5	Highest LRAA 22.23	By-product of drinking water chlorination
Total Chlorine Residual	ppm	[4.0]	[4.0]	NA	0.1 - 4.3	Highest RAA 2.54	Drinking water disinfectant added for treatment
Total Trihalomethanes (TTHM) <sup>(i)</sup>	ppb	80	NA	1	24.4 - 55.6	Highest RAA 51.52	By-product of drinking water chlorination
<b>INORGANIC CHEMICALS</b>							
Copper <sup>(j)</sup>	ppm	AL=1.3	0.03	0.05	ND - 0.78	90th Percentile 0.326	Internal corrosion of household pipes; erosion of natural deposits
Lead <sup>(j)</sup>	ppb	AL=15	0.2	5	ND	90th Percentile ND	Internal corrosion of household pipes; erosion of natural deposits
<b>SECONDARY STANDARDS – Aesthetic Standards<sup>(d)</sup></b>							
Color	Color Units	15	NA	NA	ND - 3.0	0.05	Naturally occurring organic materials
Odor Threshold	TON	3	NA	NA	ND	ND	Naturally occurring organic materials
Turbidity <sup>(c)</sup>	NTU	5	NA	NA	0.05 - 0.4	0.09	Soil runoff


## Footnotes

- <sup>(a)</sup> Treated effluent data is derived from DCMWTP samples collected between January–December 2025, representing water supplied to the public. OMWD also purchases treated water from San Diego County Water Authority. Purchased treated water quality data can be accessed by visiting [www.sdcwa.org](http://www.sdcwa.org).
- <sup>(b)</sup> OMWD targeted a fluoridation level of 0.7 ppm as prescribed by the US Department of Health and Human Services to promote dental health. Information about fluoridation, oral health, and current issues is available from [www.waterboards.ca.gov/drinking\\_water/certlic/drinkingwater/Fluoridation](http://www.waterboards.ca.gov/drinking_water/certlic/drinkingwater/Fluoridation).
- <sup>(c)</sup> Turbidity, a measure of the cloudiness of the water, is an indicator of treatment performance. As a Treatment Technique Standard, OMWD turbidity levels from the Combined Filter Effluent of the membranes were less than or equal to 0.1 NTU in 100% of the measurements taken each month and did not exceed 1.0 NTU at any time. Distribution samples (364) at OMWD were collected; the system was in compliance with the Secondary Standard.
- <sup>(d)</sup> State Secondary Standards apply to water supplied to the public by community water systems; annual monitoring is required for approved surface water sources or distribution system entry points of the effluent of source water treatment.
- <sup>(e)</sup> The USEPA's fifth Unregulated Contaminant Monitoring Rule required that public water systems test for 29 PFAS compounds and lithium in 2024. During testing, the 29 PFAS compounds were not detected by OMWD, but lithium was in 2024. The detection range was 36.3–54.1 ppb, with an average of 46.7 ppb. OMWD will include this detection in its annual CCR for five years. Sources of lithium in drinking water can be naturally occurring. Sources also include use in electrochemical cells, batteries, organic syntheses, and pharmaceuticals.
- <sup>(f)</sup> Per- and polyfluoroalkyl substances (PFAS) are a group of chemicals that are found in many different consumer, commercial, and industrial products. They are also known as “forever chemicals” because they do not break down easily. For more information on PFAS, visit [www.epa.gov/pfas/pfas-explained](http://www.epa.gov/pfas/pfas-explained). In 2025, PFBA was detected in one of four samples taken.
- <sup>(g)</sup> *E. coli*-positive sample triggers MCL violation. *E. coli* MCL violation triggers Level 2 TT assessments. No samples were *E. coli*-positive and no Level 2 assessments were required.
- <sup>(h)</sup> More than 5% total coliform-positive samples in a month triggers Level 1 assessments. No Level 1 assessments or violations occurred.
- <sup>(i)</sup> TTHM and HAA5 results for OMWD's distribution system are provided. OMWD was in compliance with all provisions of the Stage 2 Disinfectants/Disinfection By-Products Rule based on the Highest LRAA.
- <sup>(j)</sup> Lead and copper are regulated as a Treatment Technique under the Lead and Copper Rule, which requires water samples to be collected at the consumers' tap. OMWD is required to test every three years for lead and copper. If action levels are exceeded in more than 10% of the consumer tap samples, water systems must take steps to reduce these contaminants. OMWD collected samples at 30 locations in 2025; no samples exceeded the AL.

## We Encourage You to Get Involved

OMWD is governed by a five-member Board of Directors elected for staggered four-year terms, with each director being elected from a specific geographic area of OMWD's service area. Board members encourage public participation in decisions affecting our community's drinking water and any other water related issues. The public is welcome to attend board meetings. Please check OMWD's website at [www.olivenhain.com/meetings](http://www.olivenhain.com/meetings) for current information, as dates and times of board meetings vary.

## About OMWD

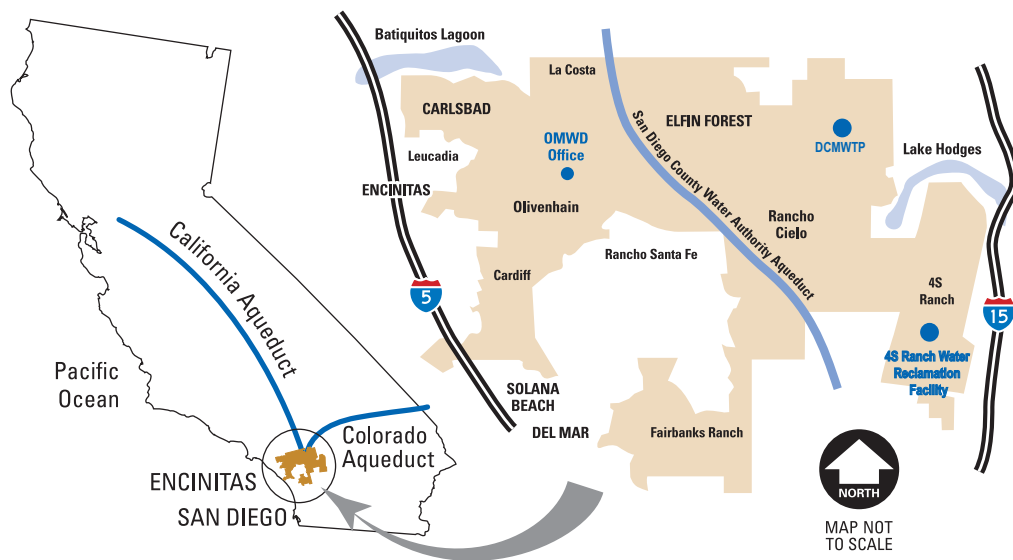

OMWD is a municipal water district organized and operating pursuant to Water Code Sections 71000 et seq., and was incorporated on April 9, 1959 to develop an adequate water supply for landowners and residents. On June 14, 1960, residents of OMWD voted to become a member of SDCWA, thus becoming eligible to purchase water transported into San Diego County via the aqueduct systems of SDCWA and MWD. At over 48 square miles, OMWD serves approximately 87,000 customers in Encinitas, Carlsbad, San Diego, Solana Beach, and neighboring communities.

## For Additional Information

For more information on this report, contact OMWD's Operations Manager at **760-753-6466** or [waterquality@olivenhain.com](mailto:waterquality@olivenhain.com).

*Este informe contiene información muy importante sobre su agua potable. Si tiene preguntas, llame al 760-753-6466.*



Municipal Water District

1966 Olivenhain Road  
Encinitas, CA 92024  
760-753-6466

[www.olivenhain.com](http://www.olivenhain.com)



Published by Olivenhain Municipal Water District in the interest of an informed public.

### Board of Directors

Matthew R. Hahn, President  
Neal Meyers, Vice President  
Christy Guerin, Secretary  
Scott Maloni, Treasurer  
Ebin Lanfried, Director

### General Manager

Kimberly A. Thorner, Esq.

### General Counsel

Alfred Smith, Esq.

### Board Meeting Dates

Please visit our website at [www.olivenhain.com/meetings](http://www.olivenhain.com/meetings) for dates.

### Mission Statement

Olivenhain Municipal Water District is a multi-functioning public agency that is dedicated and committed to serving present and future customers in a service-oriented manner by:

#### Water

Providing safe, reliable, high-quality drinking water while exceeding all regulatory requirements in a cost-effective and environmentally responsive manner.

#### Recycled Water

Providing recycled water and wastewater treatment in the most cost-effective and environmentally responsive method.

#### Parks

Safely operating the Elfin Forest Recreational Reserve and providing all users with a unique recreational, educational, and environmental experience.

#### Emergency Management

Complying with policies and procedures that adhere to local, state, and federal guidelines for national security and disaster preparedness.

#### Sustainable Operations

Pursuing alternative and/or renewable resources with the most sustainable, efficient, and cost-effective approach.

1966 Olivenhain Road  
Encinitas, CA 92024  
760-753-6466  
[www.olivenhain.com](http://www.olivenhain.com)



A Public Agency Providing:

Water • Wastewater Services • Recycled Water • Hydroelectricity • Elfin Forest Recreational Reserve